

# Fenwal Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

Flexible Discharge Hoses Data Sheet


F-44-2120



A UTC Fire & Security Company

## FEATURES

- For use with UL Listed, ULC Listed, and FM Approvals Systems

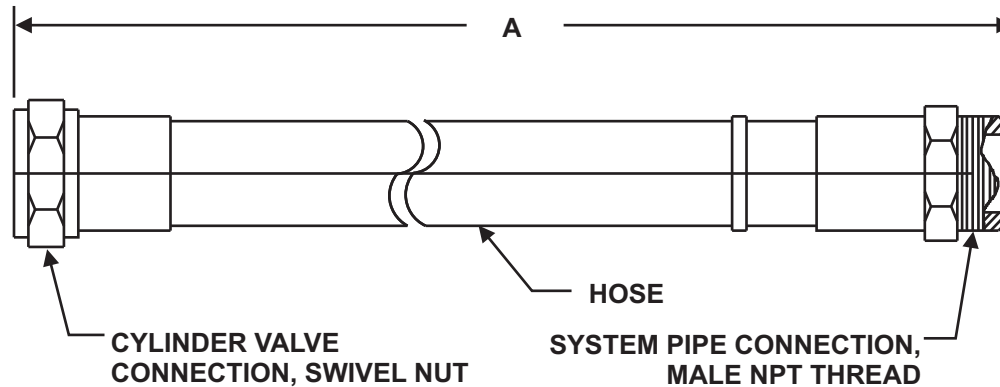

## ORDERING INFORMATION

Part Number	Male NPT	Dimension A	Minimum Bend Radius
283898	1-1/2 in. (38 mm)	24 in. (610 mm)	10-1/2 in. (267 mm)
283899	2 in. (51 mm)	31 in. (787 mm)	13-1/2 in. (343 mm)
283900	2-1/2 in. (64 mm)	48 in. (1219 mm)	22-1/2 in. (572 mm)

## MATERIALS

- Hose: Reinforced Rubber Hose
- Fitting: Brass

## TECHNICAL DATA

- Minimum Bursting Pressure: 200 PSI
- Working Pressure: 500 PSI
- Proof Pressure: 1000 PSI

Fenwal is a registered trademark of Kidde-Fenwal, Inc.  
3M and Novec are trademarks of 3M.  
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.  
If you need more information on this product, or if you have a particular question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Fenwal Protection Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.fenwalfire.com](http://www.fenwalfire.com)