

# Fenwal Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

Manifold EI-Check Data Sheet

F-44-2130




A UTC Fire & Security Company

## ORDERING INFORMATION

## FEATURES

- For use with UL Listed, ULC Listed, and FM Approvals Systems

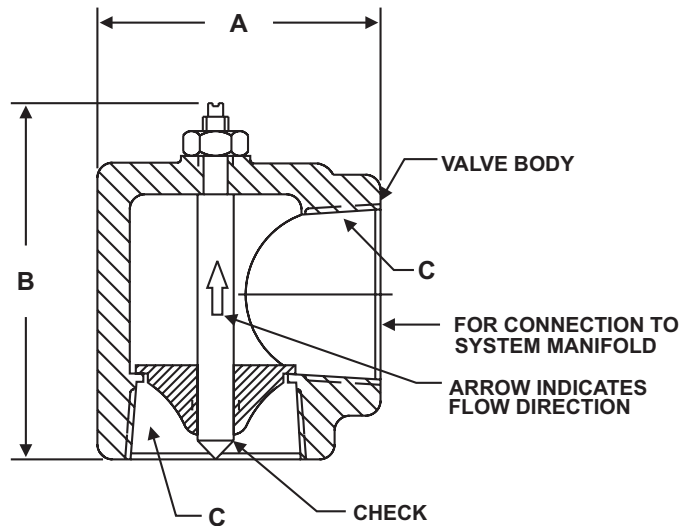

Part Number	Size	A	B	C
877690	2 in.	3-15/16 in.	4-7/8 in.	2 in. 11-1/2 in. NPT
878743	2-1/2 in.	4-11/16 in.	5-3/4 in.	2-1/2 in. 8 in. NPT

**Notes:** EI-Checks are to be installed at system manifold in vertical direction as shown.

**Do not use as a main/reserve check valve with more than one main/reserve cylinder.**

## MATERIALS

- Valve Body: Zinc Plated Steel
- Check: Stainless Steel
- Seat: Nitrile Rubber

Fenwal is a registered trademark of Kidde-Fenwal, Inc.  
3M and Novec are trademarks of 3M.  
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.

If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Fenwal Protection Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.fenwalfire.com](http://www.fenwalfire.com)