

Fenwal Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

360 Degree Pendant Nozzle Data Sheet

F-44-2140




A UTC Fire & Security Company

P/N: 44-1946XX-XXX

FEATURES

- For use with UL Listed, ULC Listed, and FM Approvals Systems

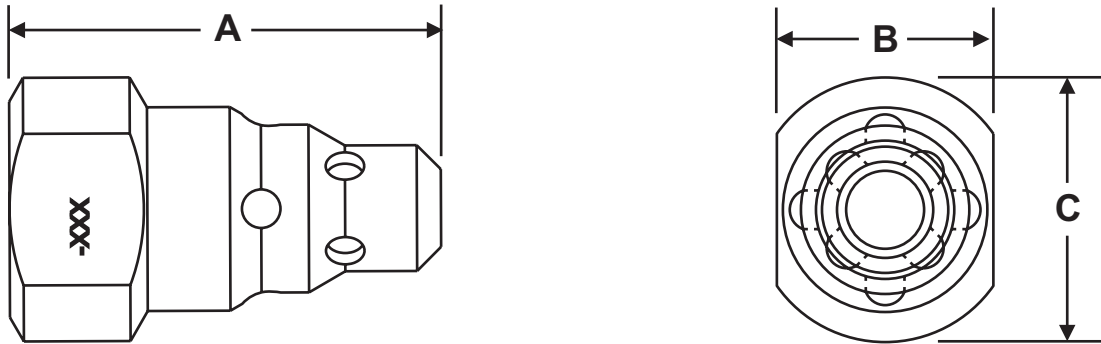

Note: A selection of orifices are available for each nozzle size and make. Consult the Fenwal Engineered Fire Suppression System Design, Installation, Operation and Maintenance Manual for details.

Pipe Size	Dimensions		
	A	B	C
1/4 in. (6 mm)	1-29/32 in. (49 mm)	1-1/32 in. (26 mm)	7/8 in. (22 mm)
3/8 in. (10 mm)	2-1/32 in. (52 mm)	1 in. (25 mm)	1-3/16 in. (30 mm)
1/2 in. (13 mm)	2-1/4 in. (57 mm)	1-1/8 in. (29 mm)	1-3/8 in. (35 mm)
3/4 in. (19 mm)	2-11/16 in. (68 mm)	1-3/8 in. (35 mm)	1-5/8 in. (41 mm)
1 in. (25 mm)	2-7/8 in. (73 mm)	1-5/8 in. (41 mm)	1-15/16 in. (49 mm)
1-1/4 in. (32 mm)	3-19/64 in. (83 mm)	2 in. (51 mm)	2-3/8 in. (60 mm)
1-1/2 in. (38 mm)	3-5/8 in. (92 mm)	2-1/4 in. (57 mm)	2-11/16 in. (68 mm)
2 in. (51 mm)	4-1/2 in. (114 mm)	3 in. (76 mm)	3-1/2 in. (89 mm)

Fenwal is a registered trademark of Kidde-Fenwal, Inc.
3M and Novec are trademarks of 3M.
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.

If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Fenwal Protection Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.fenwalfire.com